


Inspection of Portable Pressurized Fire Extinguishers

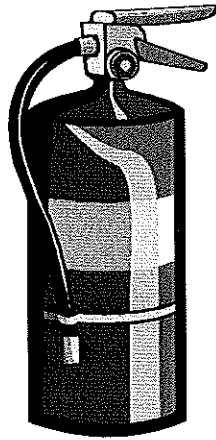

Inspection of Portable Pressurized Fire Extinguishers

Fire Extinguishers require an annual service inspection. NFPA 10:7.1.2.1

Dry Chemical (Stored Pressure)	Inspections – 7.2.1.2 30 day intervals	Maintenance – 7.3.1.1.2 1 Year	Recharging – 7.4.1.1 After every use or by inspection or maintenance interval	Hydrostatic Test Not to exceed twelve (12) year intervals
Dry Chemical (Stainless Steel)	30 day intervals	1 year	Five (5) years	Five (5) years

Maintenance is to be performed by a trained person who has undergone the instructions necessary to reliably perform maintenance and has the manufacturer's service manual. 7.1.2

Maintenance, servicing and recharging shall be performed by trained and certified persons having available the appropriate servicing manuals(s), the proper types of tools, recharge materials, lubricants, and manufacturer's recommended replacement parts or parts specifically listed for use in the fire extinguisher. 7.1.2.2


Maintenance is to be performed in full compliance with the maintenance requirements of; Manufacturers recommendations, NFPA 10 Standards for Portable Fire Extinguishers 2007 Edition;

During the time period that fire extinguishers are removed from service for maintenance or recharge a replacement fire extinguisher suitable for the type of hazard being protected and of at least equal rating is to be provided. 7.1.3

Guidelines to Inspect and Service Dry Chemical Portable Fire Extinguishers:

1. Check the underwriter's label on the nameplate: 7.1.4.2

- a. Recharging instructions must be legible.
- b. Chemical content identified.
- c. Underwriter's classification readable.

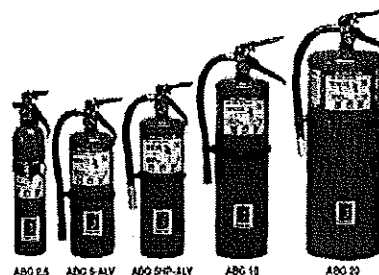

2. Check for manufacturer's date or last hydrostatic test date.

- a. The hydrostatic retest shall be conducted within the calendar year of the specified test interval. 8.3.1.1
- b. If six (6) years has past since the last recharge, the extinguisher must be taken out of service, emptied and hydrostatically tested. 7.3.1.2.1
- c. If unable to locate date, hydrostatic test must be applied to the unit before placing into service. 7.3.2.4

3. Check cylinder for damage and possible need for hydrostatic testing. 8.1.3

- a. Dents, cuts in cylinder, rust or signs of having been in a fire require hydrostatic testing.

4. Visual check of pressure gauge.

- a. Pressure gauge needle or pointer shall be pointed in the green.
- b. Are gauge graphics straight in the unit?
- c. Is dial cover clear and readable?
- d. Is the gauge damaged in any fashion?

5. Pull Pin

- a. Break seal and pull pin.
- b. Is the pull pin straight and smooth?
- c. Does pin slide smoothly and with ease out of the retainer.

6. Operating lever and carry handles:

- a. Are the lever and carrying handle in good condition
- b. There should be no cuts or gauges in the metal.
- c. Are factory type rivets installed properly and without damage.

7. Nozzle and hose

- a. Check the hose for cracks, cuts or signs of age and ware
- b. Check the hose orifice for foreign objects, clogging or signs of use.
- c. Are the hose and nozzle fit properly and designed for the extinguisher brand.

8. Perform both an external and comprehensive internal examination of the cylinder. 7.3.2.2.1

9. Extinguisher Weight

- a. Check extinguisher weight on nameplate (located under inspection or maintenance area.)
- b. Weigh the extinguisher
- c. Do the weight listed and actual weight, coincide or match.
- d. Carefully match listed weight to the weight after the refill.

10. Clean cylinder 7.3.2.2

- a. Remove old labels
- b. Clean exterior of cylinder
- c. Reset existing or new pin, attach tamper seal, clean extinguisher and attach service tag.
- d. Replace needed stickers and service tags.

11. Labels and Service tags 10:7.3.3 and 7.3.3.1 and 7.3.3.2, A.7.3.3.2 and A.8.7.2


- a. A six (6) year service label shall be affixed with a non-heat application after service.
- b. Verification of Service Collar shall be applied after maintenance service.
- c. Written signature and EE number must be legible.
- d. Year, month, day and service performed shall be marked or punched into the tag.
- e. Type of service performed and extinguisher type shall be listed.

Guidelines to Inspect Dry-Chemical Cartridge Fire Extinguishers:

Dry Chemical (Cartridge)	Inspections – 7.2.1.2 30 day intervals	Maintenance – 7.3.1.1.2 1 Year	Recharging – 7.4.1.1 After every use or by inspection or maintenance interval	Hydrostatic Test Not to exceed twelve (12) year intervals
-------------------------------------	---	---	--	--

Service Guidelines

1. Read Underwriters' label (it must be attached to the extinguisher and legible)
2. Find the date of manufacture and or the last hydrostatic test date.
3. Perform both an internal and external examination of the extinguisher. 7.3.2.4
 - a. Look for cylinder damage; rust, cuts, dents or signs of heat damage.
 - b. Determine if the extinguisher should be taken out of service or rejected due to damage.
 - c. Determine if a hydrostatic test is needed.
4. Cartridge Service
 - a. Carefully remove cartridge cover and cartridge.
 - b. Operate the puncture lever to make sure the lever works freely.
 - c. Check pressure relief vent for obstructions in the cartridge receiver.
 - d. Check thread grooves in the cartridge receiver for damage.
 - e. Remove and examine gasket in cartridge receiver.
5. Invert extinguisher and squeeze handle to relieve pressure in cylinder.
6. Open wheel cap and empty chemical contents from the cylinder in an approved manor.
7. Clean and examine the extinguisher internally.
8. Hose and Nozzle
 - a. Examine hose and nozzle for cracks, nicks, age or heat damage.
 - b. Using a compressor, blow through nozzle and hose to clear excess powder or obstructions.
 - c. Check hose attachment threads and O-ring for damage.

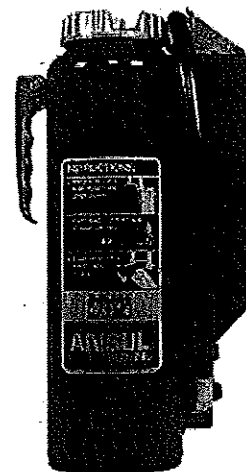

9. Wheel Indicator Cap

- a. Examine wheel indicator cap threads for damage and replace if needed.
- b. Examine and clean the red indicator slide for smooth and proper operation.
- c. Examine wheel indicator cap gaskets for damage and replace if needed.
- d. Reset red indicator plunger.
- e. Non-indicator caps shall be removed from service and replace with a properly working indicator cap.

10. Refill extinguisher 7.4.1.3 and 7.4.1.3.1

- a. Use only the correct type of chemical listed for extinguisher type
- b. Only fill extinguisher cylinder to the listed weight for extinguisher type.
- c. Clean fill orifice threads and relief vent of any residual powder.

11. Replace indicator cap


- a. Hand tighten indicator cap to cylinder.

12. Pressurized Cartridge Replacement

- a. Examine the new or used cartridge and threads for damage.
- b. Make sure the cartridge examined is the proper and listed cartridge for the extinguisher type and size.
- c. Are the cartridge threads "left-handed threaded"?
- d. Determine proper weight for the cartridge (proper weight is stamped on the cartridge.)
- e. Weigh cartridge (One half ($\frac{1}{2}$) cartridge weight loss is allowed.)
- f. May be one-half ($\frac{1}{2}$) ounce on 20 or 30 pound extinguishers.
- g. Cartridges are to be hydrostatically tested every five (5) years.
- h. Cartridge is to be hand-tightened in the cartridge retainer (left-hand turn in the cartridge retainer.)

13. Replace cartridge guard

14. Attach tamper seal, clean extinguisher, and attach service tag.

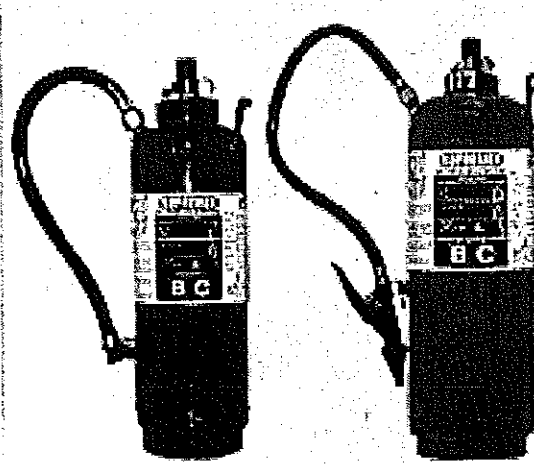


Guidelines to Inspect Stored Pressure Clean Agent Fire Extinguishers:

Clean Agents	Inspections – 7.2.1.2 30 day intervals	Maintenance – 7.3.1.1.2 1 Year	Recharging – 7.4.1.1 After every use or not to exceed six (6) year maintenance interval	Hydrostatic Test Not to exceed twelve (12) year intervals 8.3.1
--------------	---	--------------------------------------	---	---

Service Guidelines

1. Read Underwriters' label (it must be attached to extinguisher cylinder.
2. Find the date of manufacture or last hydro-test date.
3. Complete an external examination of the fire extinguisher unit.
 - a. Look for cylinder damage; rust, cuts, dents or signs of heat damage.
 - b. Determine if the extinguisher should be taken out of service or rejected due to damage.
 - c. Determine if a hydrostatic test is needed.
4. Extinguisher Weight
 - a. Weigh extinguisher and compare with manufacturers full-weight printed on extinguisher label.
 - b. Recharge extinguisher to correct weight should the weight not agree with manufacturer listing.
5. Pressure Gauge
 - a. Visually inspect the pressure gauge.
 - b. If gauge pressure needle or pointer is not in the green or shows loss or overcharge of pressure, then depressurize extinguisher.
 - c. Re-charge to accurate pressure reading.
6. Pull Pin
 - a. Remove pull pin from pin-slide and valve assembly
 - b. Check for free movement of the pin.
 - c. If the pin is bent, spurred, or damaged in any way, replace with new pull pin.

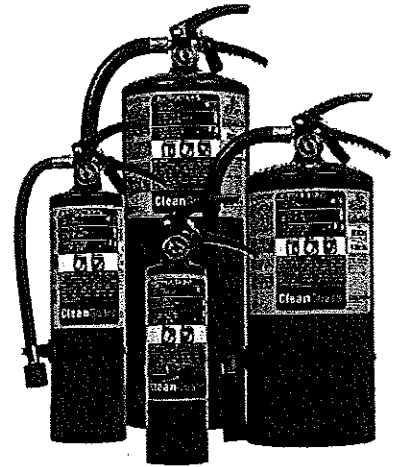

7. Hose and Horn

- a. Inspect hose and horn for cracking, degrading, age or heat damaged.
- b. Check the hose and horn for obstructions
- c. Blow nitrogen through hose and horn to insure clear passage through.
- d. Clean attachment threads and replace O-rings if necessary

8. Re-charge

- a. Recharge to correct pressure and weight

9. Install new tamper seal and clean extinguisher body, apply service label and tags.

Note:

- Labels shall be applied with a heatless process and designed to be self destructive upon removal.
- Pressure gauges shall be capable of being read to within one percent of the test pressure.
Pressure gauges used on the test equipment are to be calibrated semiannually. 8.2.1.4

Inspection Procedures for Carbon Dioxide Fire Extinguishers:

Carbon Dioxide	Inspections –7.2.1.2 30 day intervals	Maintenance and ensure conductivity exists. 7.3.1.3 1 Year	Recharging – 7.3.1.1.2 Five (5) years or by inspection or maintenance interval	Hydrostatic Test Not to exceed five (5) year intervals
-----------------------	--	---	---	--


Service Guidelines:

Read Underwriters' label (it must be attached to extinguisher cylinder body).

1. Find the date of manufacture or last hydro test date.
2. Complete an external examination of the fire extinguisher unit.
 - a. Look for cylinder damage; rust, cuts, dents or signs of heat damage.
 - b. Determine if the extinguisher should be taken out of service or rejected due to damage.
 - c. Determine if a hydrostatic test is needed.
3. Extinguisher Weight
 - a. Weigh extinguisher and compare with weight stamped on the valve.
 - b. Recharge if weight loss is greater than ten (10%) percent.
4. Pull Pin
 - a. Remove pull pin from pin-slide and valve assembly
 - b. Check for free movement of the pin.
 - c. If the pin is bent, spurred, or damaged in any way, replace with new pull pin.
5. Hose and Horn
 - a. Remove and check horn or hose and horn assembly for cracking, degrading, age or heat damage.
 - b. Check the hose and horn for obstructions.
 - c. Blow nitrogen through hose and horn to insure clear passage through the hose.
 - d. Clean attachment threads and replace o-rings if necessary.



6. Check to insure that there is a diffuser, and that it is not clogged or obstructed.
7. With the horn reattached to the discharge tube, check the movement of the swivel joint for binding or being too loose.
8. Perform a hose conductivity test. 7.3.1.3
 - a. Conductivity test results shall be recorded on a suitable label and applied to extinguisher by a heatless process.
 - b. Test equipment shall be calibrated at least semiannually. 8.2.1.4
 - c. When test is complete and assembly passed, apply the "Conductivity Tested Label" to unit. A.7.3.1.3
9. Recharge 7.4.1.3
 - a. Recharge to correct weight and pressure.
10. Service Tags 7.3.3
 - a. Written signature and EE number need to be legible.
 - b. Year, month, day and service performed should be marked or punched on the tag.
 - c. Type of service performed, extinguisher type.
11. Full Service Extinguisher
 - a. Install new tamper seal
 - b. Clean extinguisher body
 - c. Remove old labels from cylinder
 - d. Apply completed service labels and tags.

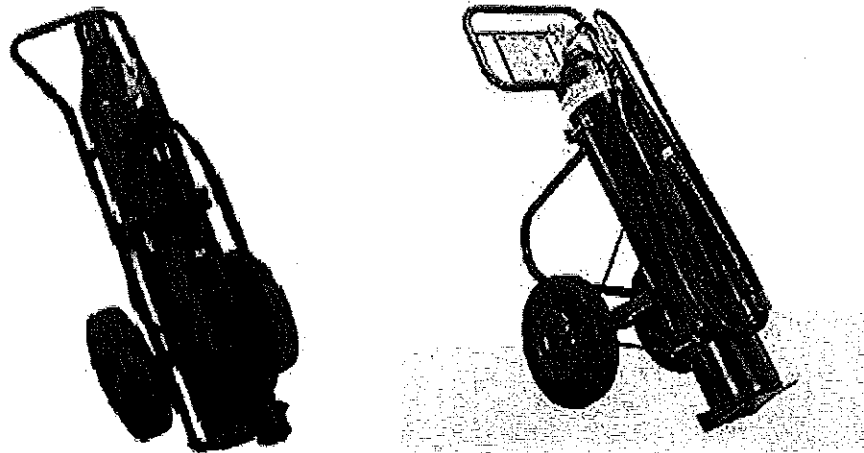

Wheeled CO2 Fire Extinguishers

Inspection and Recharging Procedures for Pressurized Water Fire Extinguishers:


Water Type Extinguishers include: water, antifreeze, wetting agent, and loaded stream fire extinguishers

Note: Recharging procedures should be followed after any use of the extinguisher and after the conducting of hydrostatic testing.


Water (Stored Pressure)	Inspections – 7.2.1.2 30 day intervals	Maintenance – 7.3.1.1.2 1 Year	Recharging – 7.4.1.1 After every use, by inspection or at maintenance intervals	Hydrostatic Test Table 8.3.1 Not to exceed five (5) year intervals
-----------------------------------	--	---	---	---

Recharging:

1. Discharge extinguisher into a container. (Retain expelled charge for testing.)
2. At the top of the cylinder, loosen hex nut with a spanner or open-end wrench (Do not use a pipe wrench for this operation.)
3. Remove valve assembly
4. Remove overfill tube and examine for damage.
5. Flush the cylinder shell with clear tap water.
6. Test retained charge using a “hydrometer” (automotive engine coolant type) to determine freeze point.
7. Examine interior of shell for obvious evidence of corrosion or damage.
8. Examine threaded (mail thread) collar for evidence of damaged threads. (Shells with severely damaged threads must be scrapped.)
9. Remove siphon tube from valve. Examine for evidence of cracks or other damage. (Replace siphon tube assembly if any damage is found.
10. Remove spring and valve stem assembly. Clean as required. Replace spring if compression value of spring has been significantly reduced.
11. Carefully examine plunger. If seal has taken a set, which may prevent proper pressure seal, replace with factory furnished part. It is important to lubricate o-ring lightly prior to reinstallation.
12. Examine neck o-ring for evidence of damage, wear or imbedding of foreign material. Replace if necessary, using appropriate part. It is important to lightly lubricate o-ring upon reinstallation.

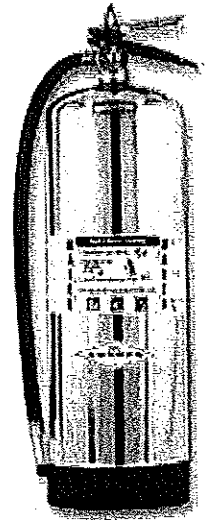

13. Check threads of union (Hex) ring.
14. Clean interior of valve and other components with soft brush (toothbrush) and lint free cloth. Lightly lubricate plunger seal and o-ring with silicone grease and re-insert into valve. Re-assemble valve.
15. Carefully, fit the overfill tube into the shell avoiding a strained or cocked condition.
16. Fill shell with water or anti-freeze charge until it rises up through the overfill tube. Fill level is the bottom of the overfill tube.
17. Install valve assembly being careful not to cross thread the union (hex) ring. Tighten with spanner or open-end wrench. (Do not use a pipe wrench for this operation.)
18. Pressurize (with compressed air or nitrogen, both regulated to operating pressure of extinguisher at source) until 100 p.s.i. is reached on charging system gauge. Check extinguisher gauge accuracy by using calibrated gauge with air chuck at "Schrader valve".
19. Leak check at all potential leakage points. Use mild soapy solution or commercially available solution such as "Leak-Tek". Clean off afterward with water. Air dry.
20. Re-install hose assembly.
21. Insert a clean, straight pull pin and tie on with a new tamper seal. Attach a completely filled out and dated recharge tag.
22. Wetting Agents
 - a. The agent in stored-pressure wetting agent fire extinguishers shall be replace annually.

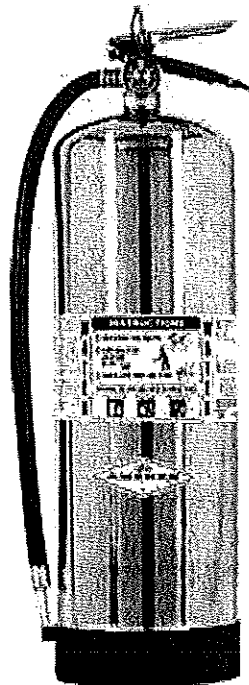

Inspection and Recharging Procedures for AFFF and FFFP Fire Extinguishers:

1. The premixed agent in liquid charged-type AFFF and FFFP fire extinguishers shall be replaced at least once every three (3) years. 7.4.2.3.1
2. Only the foam agent indicated on the extinguisher nameplate shall be used for recharge.
3. In non-pressurized AFFF and FFFP fire extinguishers that are subjected to agent analysis shall not be required to comply with 7.4.2.3.1.

Inspection and Recharging Procedures for Wet Chemical Fire Extinguishers:

Note: Recharging procedures should be followed after any use of the extinguisher and after the conducting of hydrostatic testing.

Wet Chemical (Stored Pressure)	Inspections – 7.2.1.2 30 day intervals	Maintenance – 7.3.1.1.2 1 Year	Recharging – 7.4.1.1 After every use, by inspection or at maintenance intervals	Hydrostatic Test Table 8.3.1 Not to exceed five (5) year intervals
---	---	---	--	---

Service Guidelines:

1. Read Underwriters' label (it must be attached to extinguisher cylinder body.
2. Find the date of manufacture or last hydro test date.
3. Complete an external examination of the Wet Chemical fire extinguisher unit.
 - a. Look for cylinder damage; rust, cuts, dents or signs of heat damage.
 - b. Determine if the extinguisher should be taken out of service or rejected due to damage.
 - c. Determine if a hydrostatic test is needed.
4. Extinguisher Weight
 - a. Weigh extinguisher and compare with weight stamped on the label.
 - b. Recharge if wet chemical extinguisher was partially discharged. All remaining agent shall be discarded. 7.4.3.11.2
5. Pressure Gauge
 - a. Visually inspect the pressure gauge.
 - b. If gauge pressure needle or pointer is not in the green or shows loss or overcharge of pressure, then depressurize extinguisher.



- c. Re-charge to accurate pressure reading.
- 6. Pull Pin
 - a. Remove pull pin from pin-slide and valve assembly
 - b. Check for free movement of the pin.
 - c. If the pin is bent, spurred, or damaged in any way, replace with new pull pin.
- 7. Hose and Nozzle
 - a. Remove and check hose and nozzle assembly for cracking, degrading, age or heat damage.
 - b. Check the hose for obstructions.
 - c. Blow nitrogen through hose to insure clear passage through the hose.
 - d. Clean attachment threads and replace o-rings if necessary.
 - e. Hose and wand assemblies shall be replaced by hose and nozzle assembly.
 - f. Check to insure that the diffuser is not clogged.
- 8. Recharge
 - a. Recharge to correct weight and pressure.
- 9. Service Tags
 - a. Written signature and EE number need to be legible.
 - b. Year, month, day and service performed should be marked or punched on the tag.
 - c. Type of service performed, extinguisher type.
- 10. Full Service Extinguisher
 - a. Install new tamper seal
 - b. Clean extinguisher body
 - c. Remove old labels from cylinder
 - d. Apply completed service tag.



Hydrostatic Test and Pressures ("Non-D.O.T." Fire Extinguishers Only)

Pre-test operations: Before testing the tank, it shall be emptied, be cleaned with no residual caked powder or residue remaining, and the interior shall be lighted for a full interior damage review. 8.5.1.2 Any distortion of the shell shall be cause for rejection. 8.5.2.5 Where the extinguisher shell or cartridge have one or more areas of the conditions found in NFPA 10:8.4.2 the tank or cylinder shall not be tested.

Should a corrosion, cuts, gouges or dings have removed more than 10 percent of the cylinder thickness or a dent in the cylinder includes a weld and or exceeds one quarter (1/4) inch in depth the cylinder or tank shall be condemned and not tested. 8.7.2.(1)(2)(3) and 8.4.2 and 8.4.2(7)(8)

All valves internal parts and hose assemblies shall be removed. 8.5.1.2. However, Manufacturers Recommendations may require certain internal parts shall not be removed. 8.5.1.2.1.

Relief devices shall be removed and all tests shall be conducted using test fittings and adaptors. 8.5.2.4

Stored Pressure Types: All stored pressure and bromochlorodefluomethane (Halon 1211) types of extinguishers shall be hydrostatically tested at the factory, test pressure not to exceed 3 times the service pressure. This pressure is to be maintained for a minimum of 30 seconds. A drop in pressure on the test gauge during the test procedure is cause for a retest or rejection of the cylinder. 8.5.2.6. This group includes dry chemical and water pressure extinguishers. 8.5.1.1

Cylinder and hose assemblies shall be tested within a protective cage device or placed behind a protective shield that permits visual observation while under pressure. 8.2.4.1

EXAMPLE #1

Factory test 500 p.s.i.

Service Pressure on Gauge 100 p.s.i.

Hydrostatically tested at manufacturers listed pressure or 300 p.s.i.

EXAMPLE #2

Factory test 390 p.s.i.

Service Pressure on Gauge 195 p.s.i.

Hydrostatically tested manufacturers listed pressure or at 390 p.s.i.

Where there is no pressure specified on the extinguisher nameplate the extinguisher shall be tested not to exceed three times the normal operating pressure. 8.6.1.1

Post Test: To dry the interior of the cylinder heated air is to be used at a temperature not to exceed 150° F (66° C) inside the shell.

Hydrostatic test labels are to be applied to the cylinder with month and year test was performed, test pressure, name of agency performing the test. 8.7.2.1

Cylinders tested by volumetric expansion (water jacket) test method shall be marked with a retester

identification number (RIN) on the label. 8.7.2.3(1)

Cartridge Dry Chemical Type: Cartridge operated dry chemical and dry powder types of extinguishers shall be hydrostatically tested at their original factory test pressure as shown on the nameplate or shell.

The test interval shall be the same for fire extinguisher hose assemblies equipped with a shutoff nozzle at the end of the hose as the associated extinguisher unit. 8.3.3.3

